


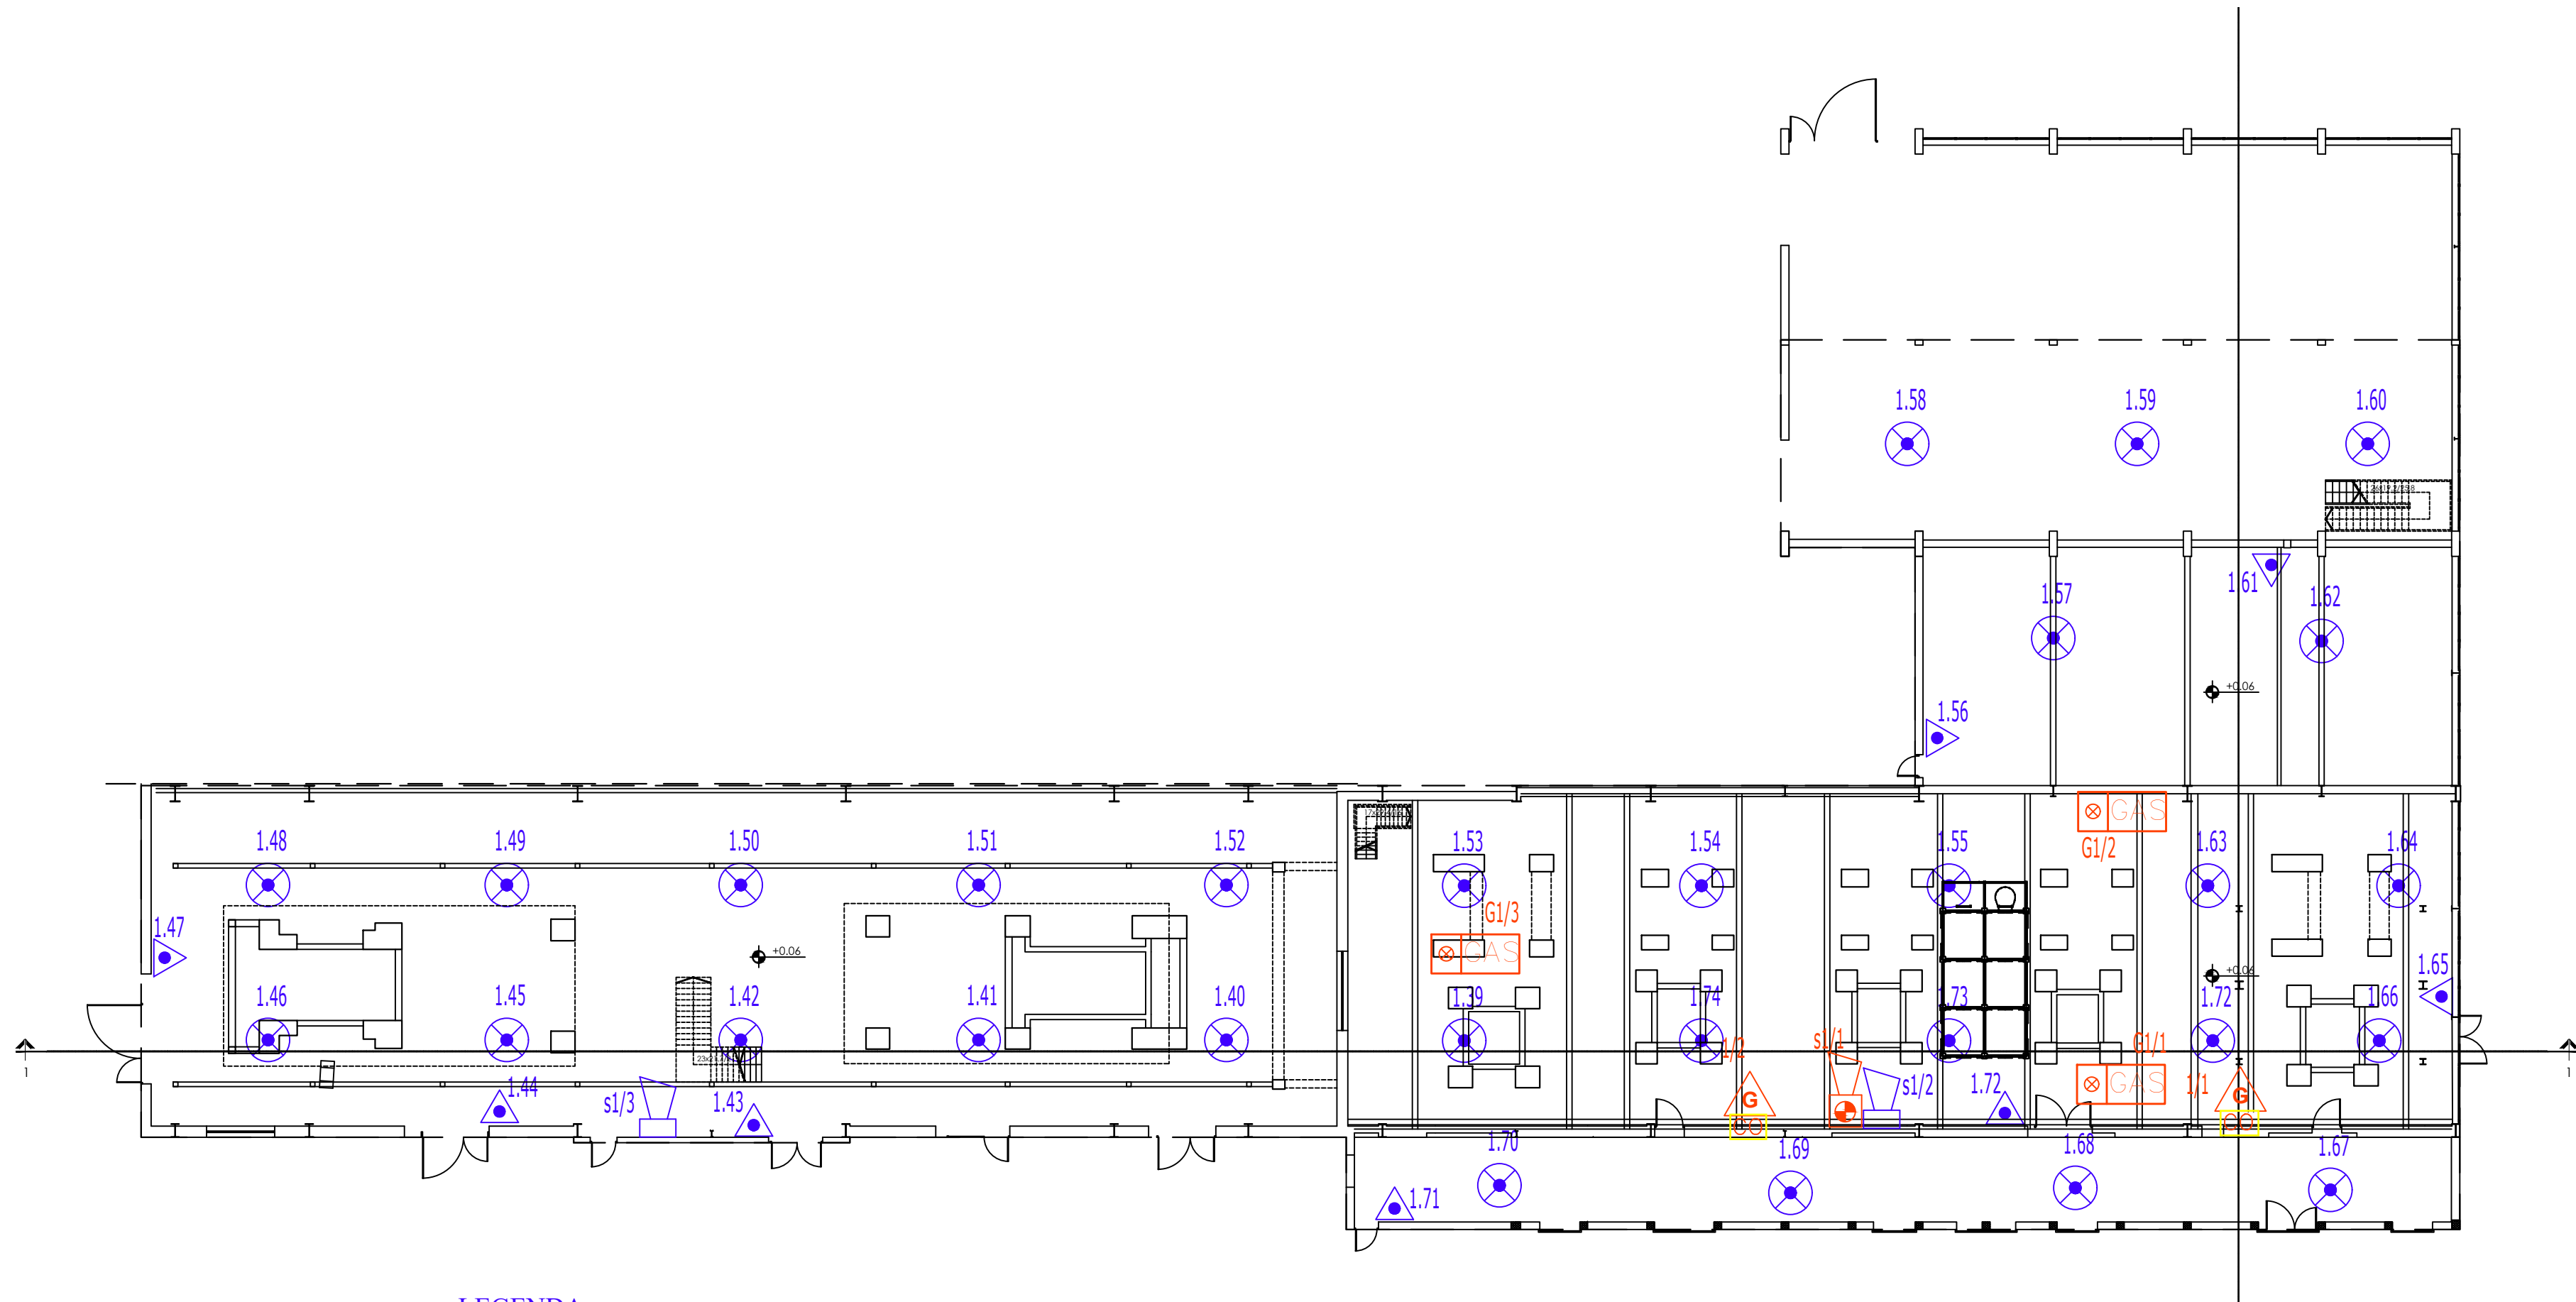

LEGENDA

OZNAKA TIP

- PPC Centralna jedinica dojave pozara
- REL4 Adresabilni modul sa 4 relejna izlaza
- Kombinovani detektor
- Kombinovani detektor u spustenom plafonu
- Termički detektor
- Paralerni indikator
- Rucni javljac pozara (unutrasnji)
- Rucni javljac pozara (spoljasnji IP-67)
- Sirena za uzbunu (unutrasnja)
- Sirena za uzbunu (spoljasnja IP-67)
- Bljeskalica


Instalacija dojave pozara je izvedena vodovima
JHStH 2x2x0,8 mm² i JHStH FE180/E90 2x1,5mm² (sirene).

- Kabel J-H(St)H 2x2x0.8mm
- Kabel J-H(St)H FE180/E30 2x2x0.8mm
- Kabel N2XH 3x1.5mm²
- x/y x-broj petlje/y-broj elementa u petlji

- CDG Centralna jedinica detekcije gasa
- G Detektor gasa - Ugljenmonoksid
- Alarmna svetiljka sa buzzerom
- Znak upozorenja "opasnost od trovanja"
- x/y x-broj petlje/y-broj elementa u petlji

- REL4 Adresabilni modul sa 4 relejna izlaza
- Svetleći upozoravajući dvostrani/jednostrani panel
- Kabel J-H(St)H 2x2x0.8mm
- Kabel N2XH 3x1.5mm²

REV	DATUM	RAZLOG	PROJEKTANT	ODOBRI
		D.O.O. "ENERGETIKA"		
Investitor		Prvoslava Rakovića 4a, Kragujevac		
Objekat		Kotlarnica "Zastava" Ulica Prvoslava Rakovića 4a, Kragujevac k.p. br. 7405/12, K.O. Kragujevac		
Sadržaj		Dojava požara i detekcija gasa - Osnova prizemlja		
Projektant		Darko Lukić, dipl.inž.el.		
Br. projekta E-21287-5/2	Faza	PGD	Datum	12.2021.
	Razmera	1:200	Br. crt.	1

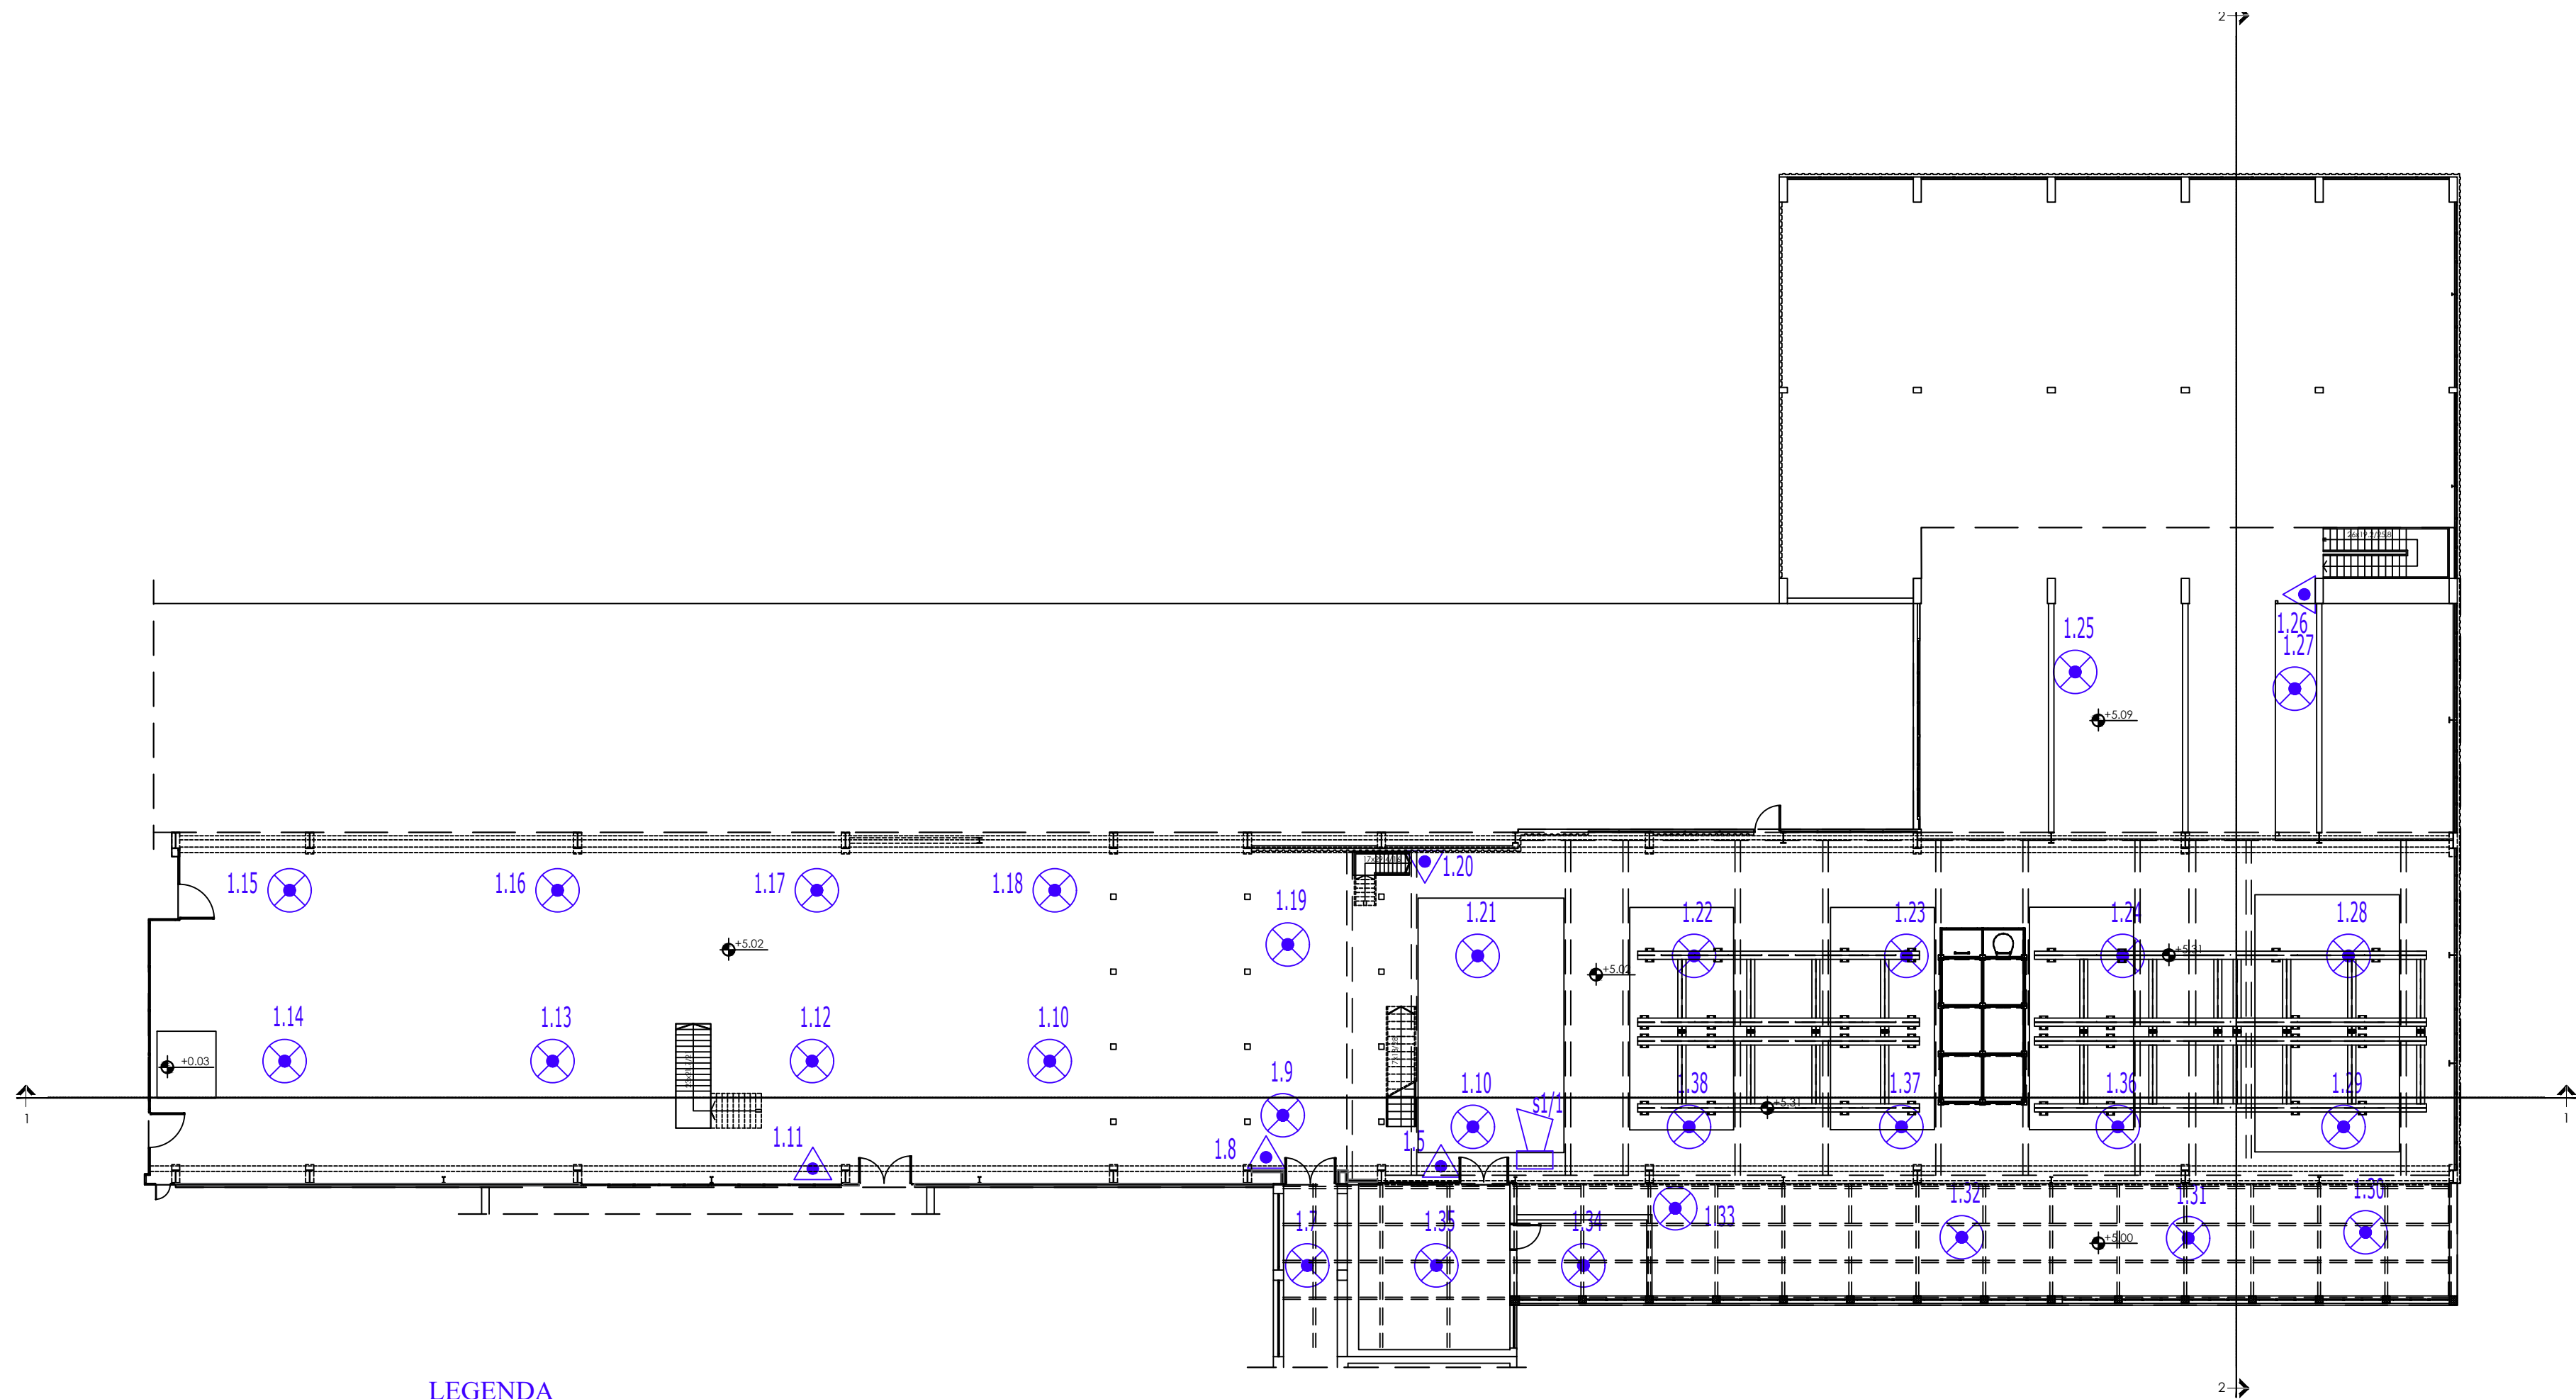

LEGENDA

OZNAKA TIP

- PPC Centralna jedinica dojave pozara
- REL4 Adresabilni modul sa 4 relejna izlaza
- Kombinovani detektor
- Kombinovani detektor u spustenom plafonu
- Termički detektor
- Paralerni indikator
- Rucni javljac pozara (unutrasnji)
- Rucni javljac pozara (spoljasnji IP-67)
- Sirena za uzbunu (unutrasnja)
- Sirena za uzbunu (spoljasnja IP-67)
- Bljeskalica

Instalacija dojave pozara je izvedena vodovima
JHStH 2x2x0,8 mm² i JHStH FE180/E90 2x1,5mm² (sirene).

- Kabel J-H(St)H 2x2x0.8mm
- Kabel J-H(St)H FE180/E30 2x2x0.8mm
- Kabel N2XH 3x1.5mm²

x/y
x-broj petlje/y-broj elementa u petlji

- CDG Centralna jedinica detekcije gasa
- Detektor gasa - Ugljenmonoksid
- Alarmna svetiljka sa buzzerom
- Znak upozorenja "opasnost od trovanja"
- x/y x-broj petlje/y-broj elementa u petlji

- REL4 Adresabilni modul sa 4 relejna izlaza
- Svetleći upozoravajući dvostrani/jednostrani panel
- Kabel J-H(St)H 2x2x0.8mm
- Kabel N2XH 3x1.5mm²

REV	DATUM	RAZLOG	PROJEKTANT	ODOBRI
		Investitor		
		D.O.O. "ENERGETIKA" Prvoslava Rakovića 4a, Kragujevac		
		Objekat		
		Kotlarnica "Zastava" Ulica Prvoslava Rakovića 4a, Kragujevac k.p. br. 7405/12, K.O. Kragujevac		
		Sadržaj		
		Dojava požara i detekcija gasa - Osnova I sprata		
		Projektant		
		Darko Lukić, dipl.inž.el.		
Br. projekta		Faza	PGD	Datum
E-21287-5/2		Razmera	1:200	12.2021.
			Br. crt.	2

OZNAKA TIP


- | | |
|---|--|
|  | Centralna jedinica dojave požara |
|  | Adresabilni modul sa 4 relejna izlaza |
|  | Kombinovani detektor |
|  | Kombinovani detektor u spustenom plafonu |
|  | Termički detektor |
|  | Paralerni indikator |
|  | Rucni javljac požara (unutrasnji) |
|  | Rucni javljac požara (spoljasnji IP-67) |
|  | Sirena za uzbunu (unutrasnja) |
|  | Sirena za uzbunu (spoljasnja IP-67) |
|  | Bljeskalica |

Instalacija dojave požara je izvedena vodovima
JHStH 2x2x0,8 mm² i JHStH FE180/E90 2x1,5mm² (sirene).

- | | |
|---|--|
| | Kabel J-H(St)H 2x2x0.8mm |
| | Kabel J-H(St)H Fe180/E30 2x2x0.8mm |
| | Kabel N2XH 3x1.5mm ² |
| X/Y | x-broj petlje/y-broj elementa u petlji |

- | | |
|---|--|
|  | Centralna jedinica detekcije gasa |
|  | Detektor gasa - Ugljenmonoksid |
|  | Alarmna svetiljka sa buzzerom |
|  | Znak upozorenja "opasnost od trovanja" |
|  | x-broj petlje/y-broj elementa u petlji |

- | | |
|---|---|
|  | Adresabilni modul sa 4 relejna izlaza |
|  | Sveteći upozoravajući dvostrani/jednostrani panel |
|  | Kabel J-H(St)H 2x2x0.8mm |
|  | Kabel N2XH 3x1.5mm² |

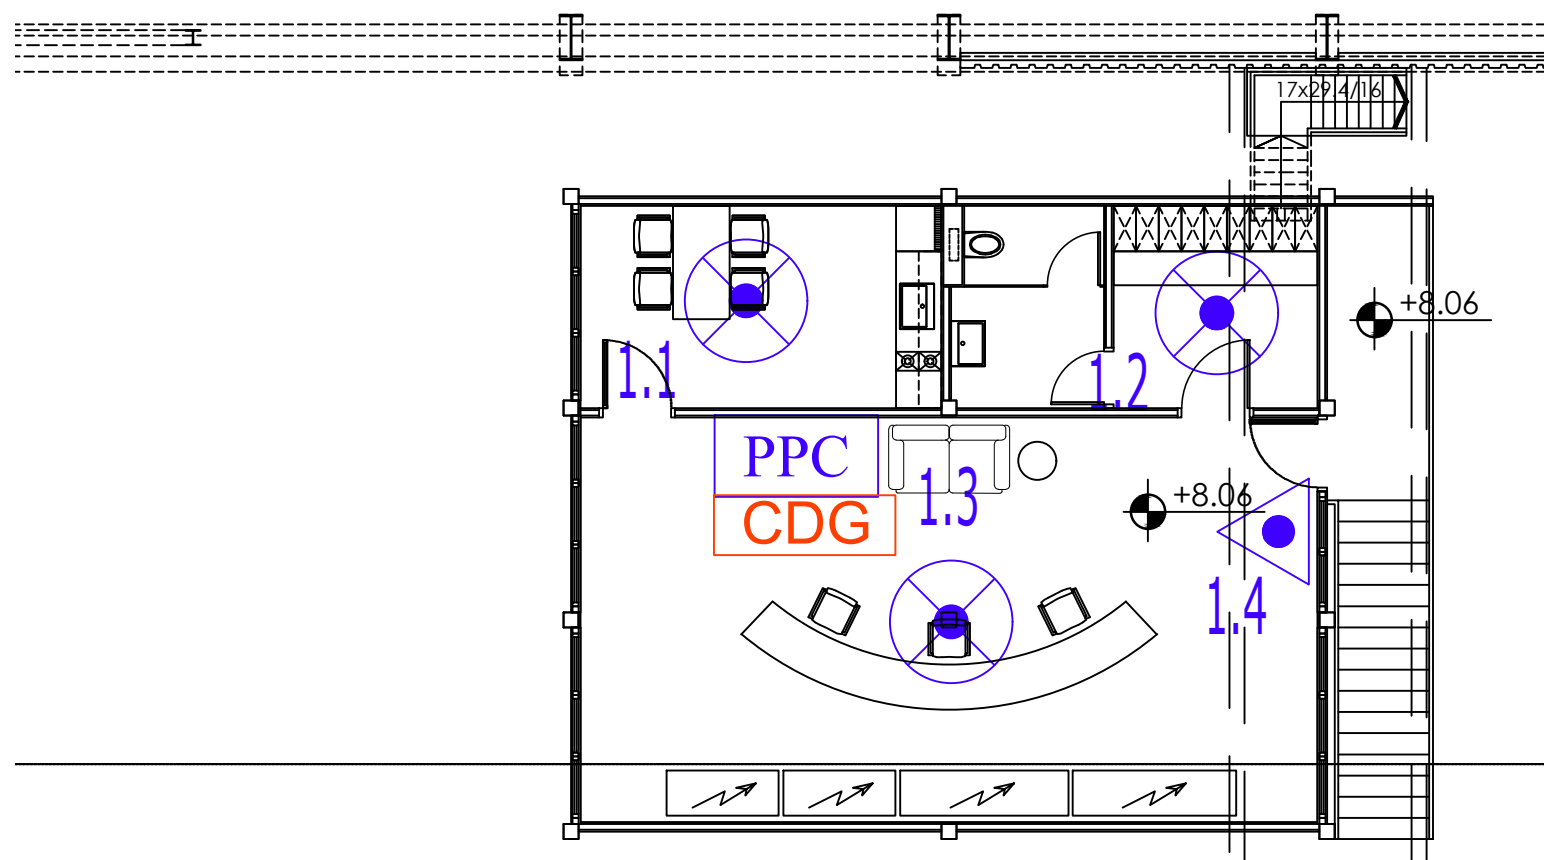

REV	DATUM	RAZLOG	PROJEKTANT	ODOBRIO
 ELSE GROUP ELECTRO LIGHTING SAFETY				
Investitor	D.O.O. "ENERGETIKA" Prvoslava Rakovića 4a, Kragujevac			
Objekat	Kotlarnica "Zastava" Ulica Prvoslava Rakovića 4a, Kragujevac k.p. br. 7405/12, K.O. Kragujevac			
Sadržaj	Dojava požara i detekcija gasa - Komandni centar			
Projektant	Darko Lukić, dipl.inž.el.			
Br. projekta E-21287-5/2	Faza	PGD	Datum	12.2021.
	Razmera	1:100	Br. crt.	3