

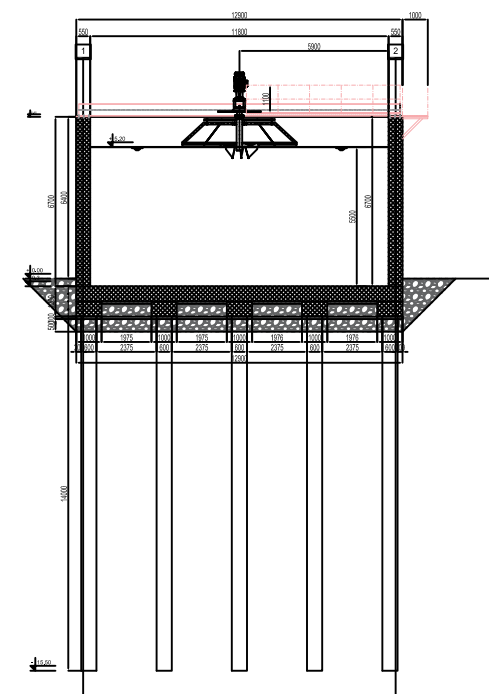


OSNOVA +6,400

PRESEK 1-1

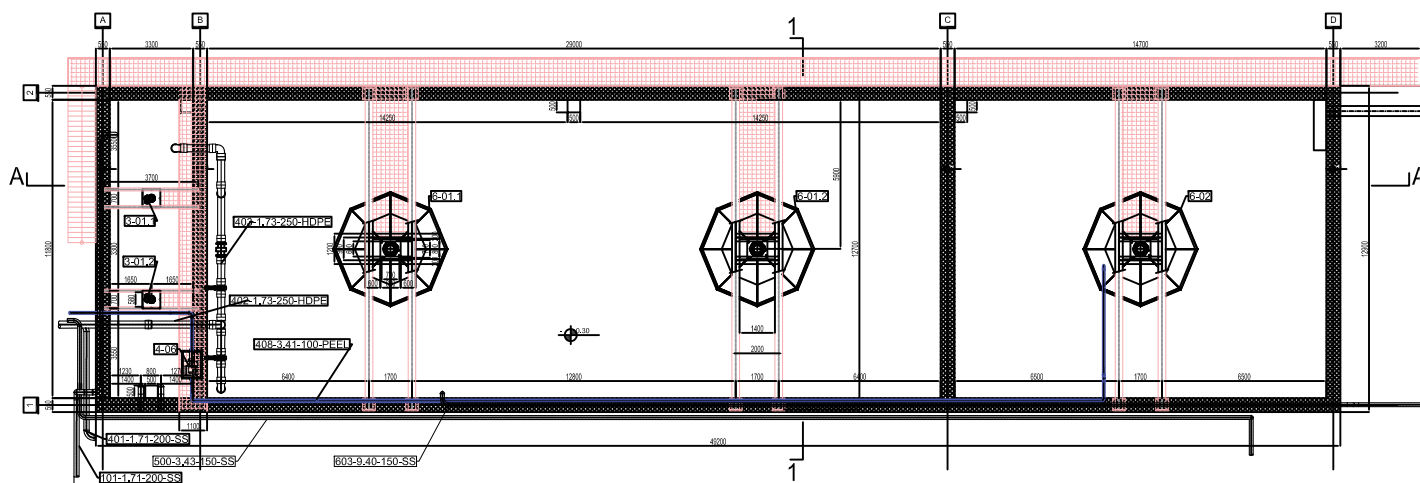


PRESEK A-A

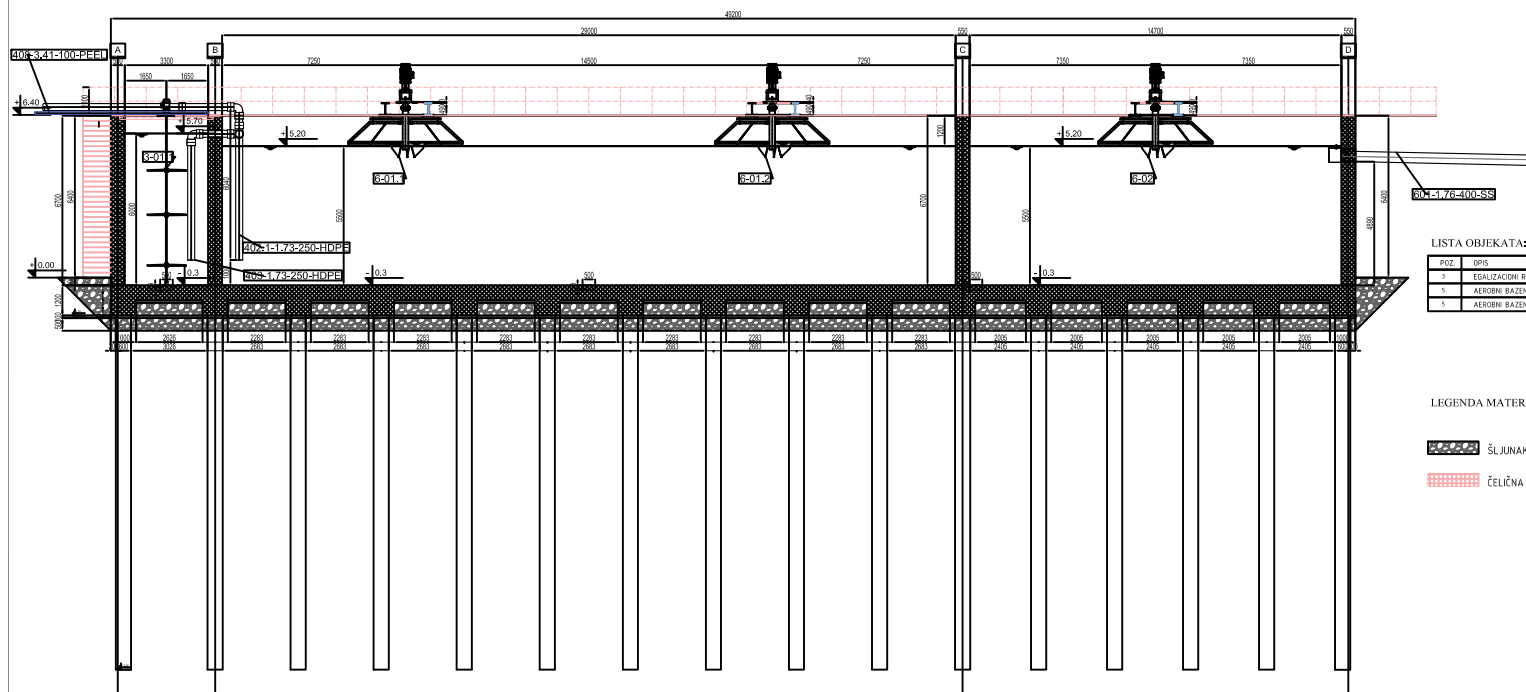

LISTA OBJEKATA:

POZ.	OPIS	ZAPREMINA (m ³)	EF ZAPREMINA (m ³)	UBINA VODE (m)	TIP KROVA	TEMPERATURA / pH FLUI
3	EGALIZACION REZERVORAR	250	230	6,0	OTVORENO	20°C - 40°C / 5,5 - 8,5 pH
5	AEROBNI BAZEN-KOHODA 1	2220	1880	5,5	OTVORENO	20°C - 40°C / 6 - 8,5 pH
5	AEROBNI BAZEN-KOHODA 2	1120	950	5,5	OTVORENO	20°C - 40°C / 6 - 8,5 pH

LEGENDA MATERIJALA:



±0,000 - +76,00

[illegible]